


Mechanical Closet - Lighting LCP

AV Notes:

Electrical Notes

- QSPS-10PNL need blocking to float the box flush
- IO- Panel is for motion Sensors
- Security Pannels needs Network

- ONQ-20 Needs a 15amp Circuit
- Security Panels Need an outlet
- QSPS- Needs 20amp Dedicated Circuit

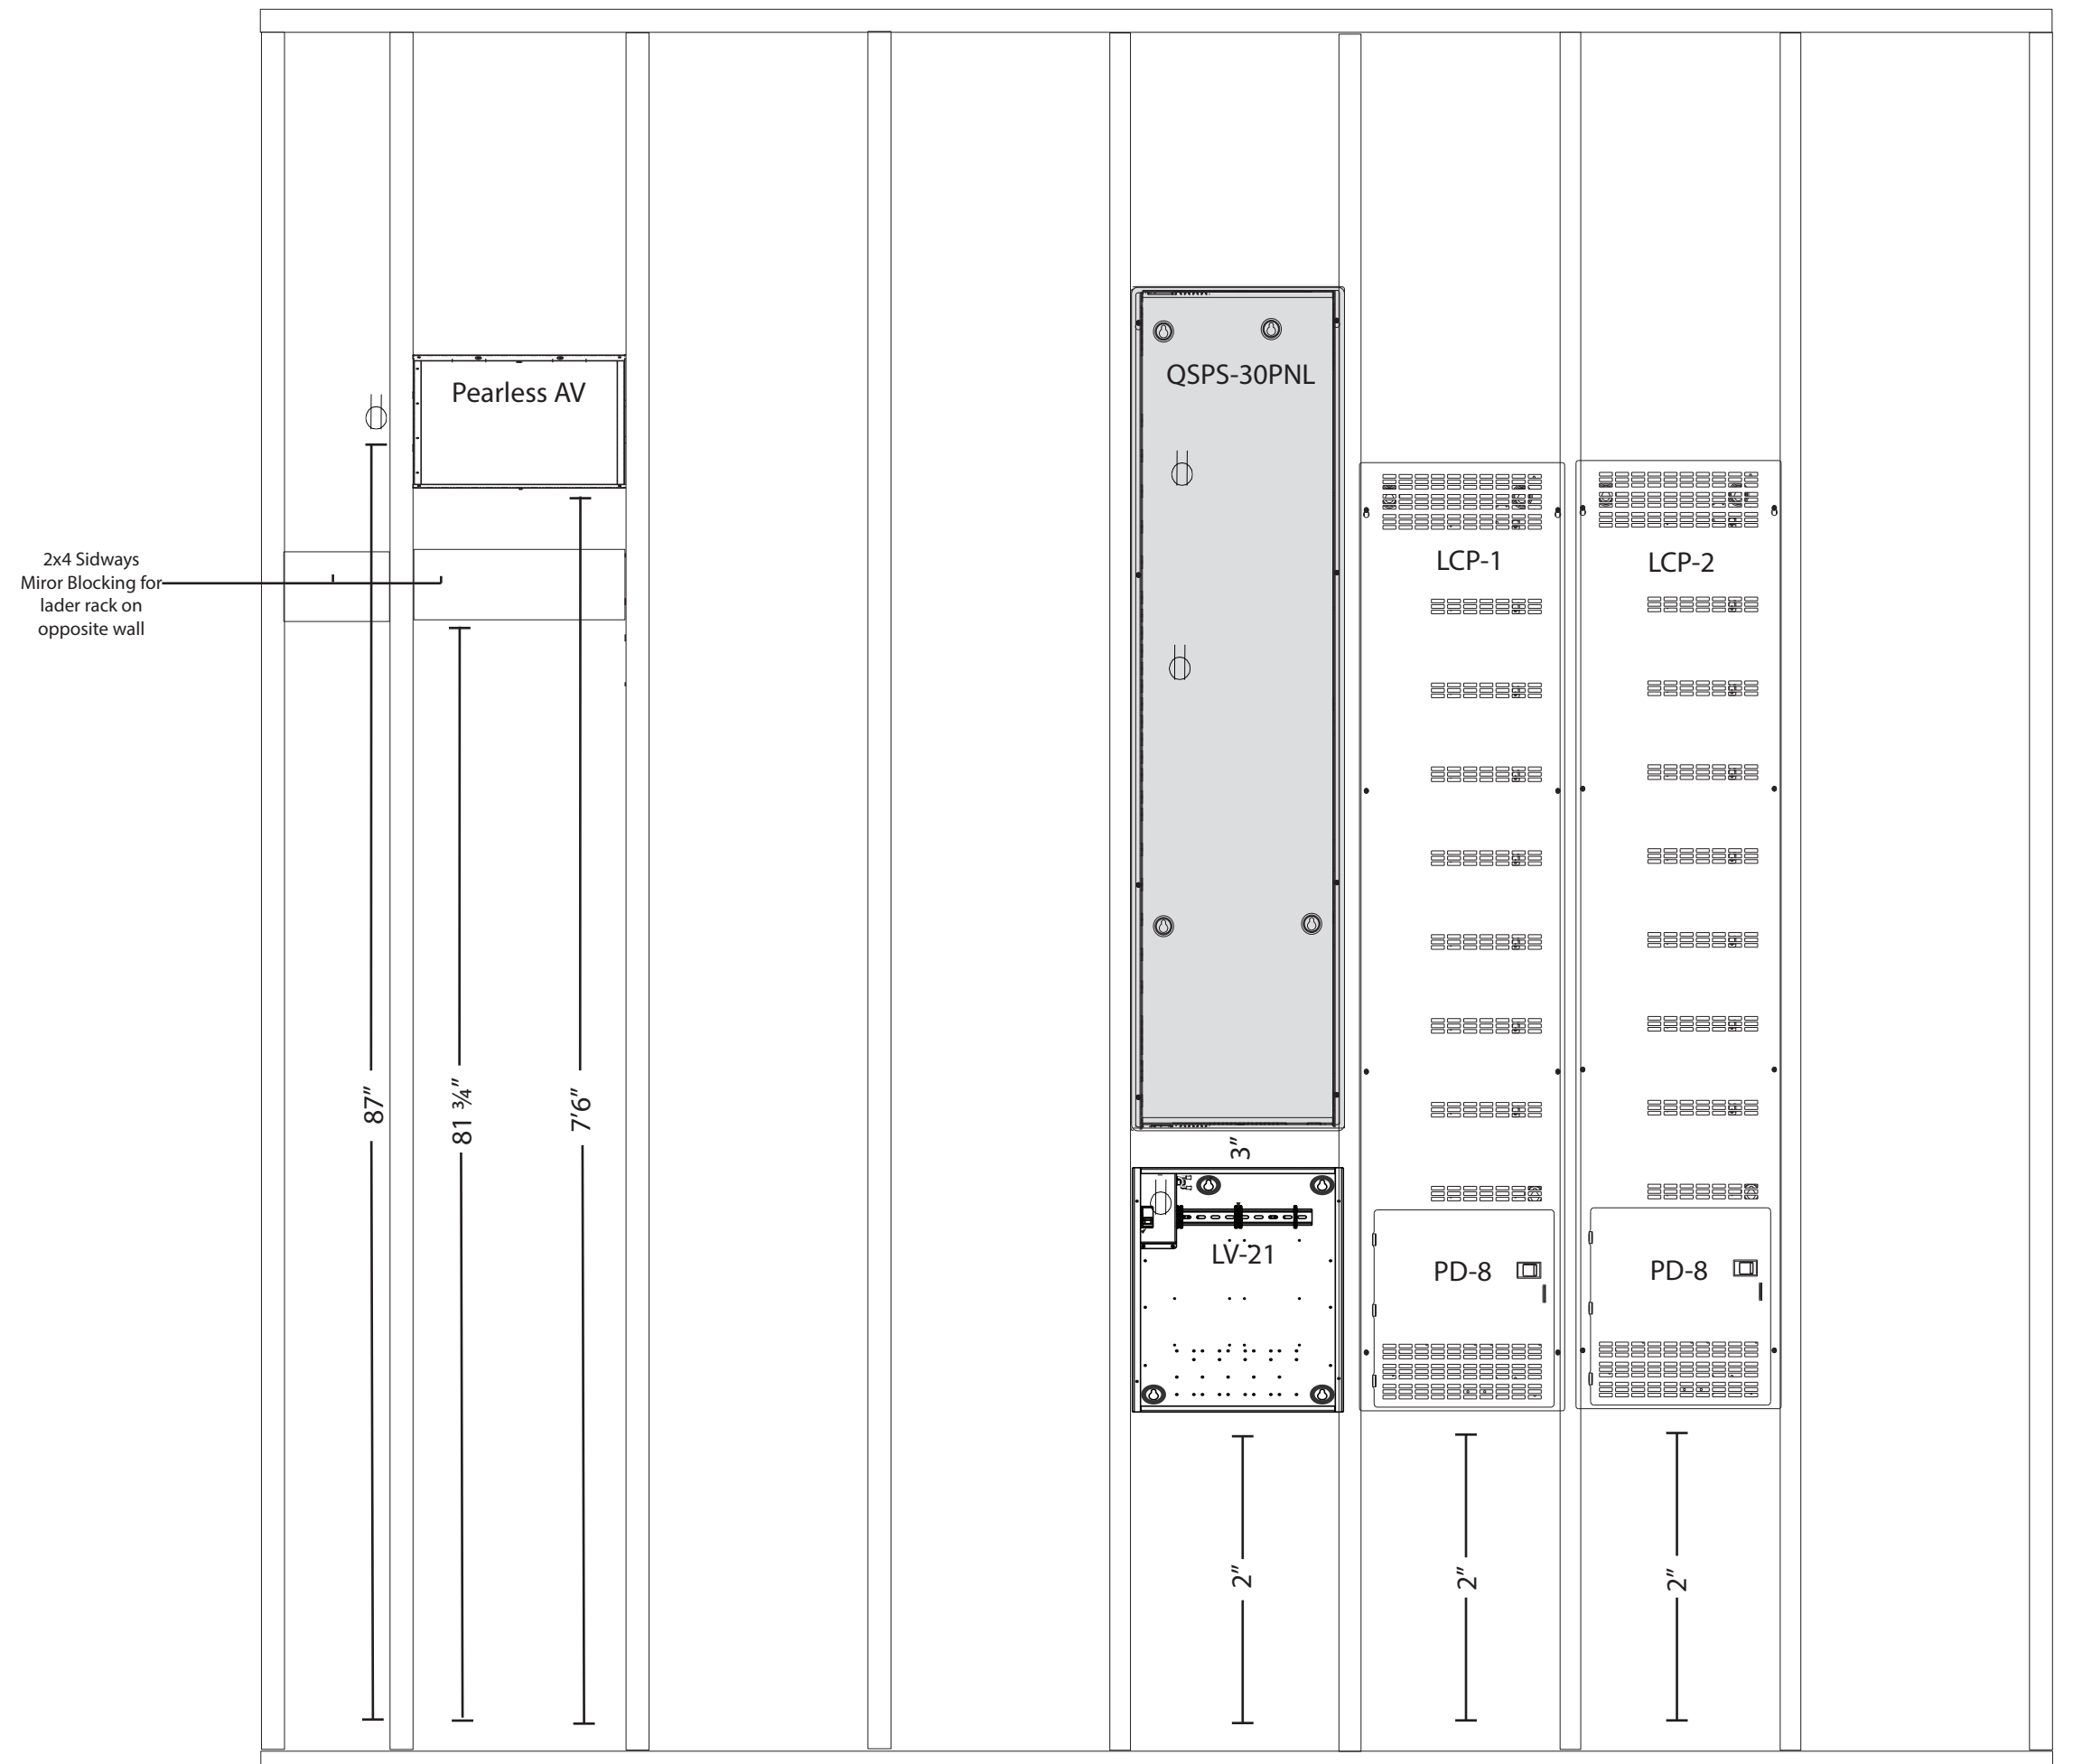

AV Closet - Lighting LCP

AV Notes:

Electrical Notes

- All AV trunks will pass through Pearless AV box
- All QS Wiring will go to LV 21
- 14" ONQ Pannel will be on the shared wall Between laundry room & AV Closet
- ONQ Pannel needs a 3/4 conduit swept from the bottem of the Pearless AV Box
- Install Blocking for Ladder Rack

- QSPS-30PNL- Needs 2 Dedicated 20 amp Circuits
- LV21- Needs a 15amp Circuit
- AV Rack Needs Dedicated 20 Amp Circuit To the left of the Pearless AV Box
- ONQ needs 15 amp Circuit